

SALISBURY

by Honeywell

GREENJACKET®

1.877.406.4501

GreenJacket: Site Protection Plan

Utility: Power Company

Project: Bus Plugs

Date: 5-July-11

Pages: 4

The Site Protection Plan remains the property of Greenjacket® and is not for distribution external of Power Company.




**TO ENSURE PROPER COVER PLACEMENT,
ALWAYS REVIEW THIS SPP BEFORE INSTALLING**

The Site Protection Plan remains the property of Greenjacket® and is not for distribution external of Power Company.

IMPORTANT INSTALLATION NOTES

1. Conductor Cover always goes on first.
2. Complete coverage is critical. Any modification to covers must be agreed on before pieces are cut.
3. If field modifications are needed, cover is cut on the ground by 1 person wearing proper PPE, including Kevlar gloves and sleeves. If a cover is damaged during modification, it may not be providing full protection. Obtain a replacement.
4. On the attached sheets, covers are described as quantity of, followed by part number and additional information, if any.
5. Air gap requirements must be met when installing covers. Refer to relevant Codes, Standards, and Regulations for your location.
6. For information on preserving BIL ratings, refer to the Installation Instructions sheets shipped with the covers.
7. For more detailed information, refer to the Installation Instructions shipped with the covers, or contact Greenjacket® at 1.877.406.4501.
8. For drainage purposes, install covers so open flange is facing down or drill 1/4" drainage holes.
9. Greenjacket covers are polyurethane and pose no health risks. (MSDS not required.)

SPP NOTATION

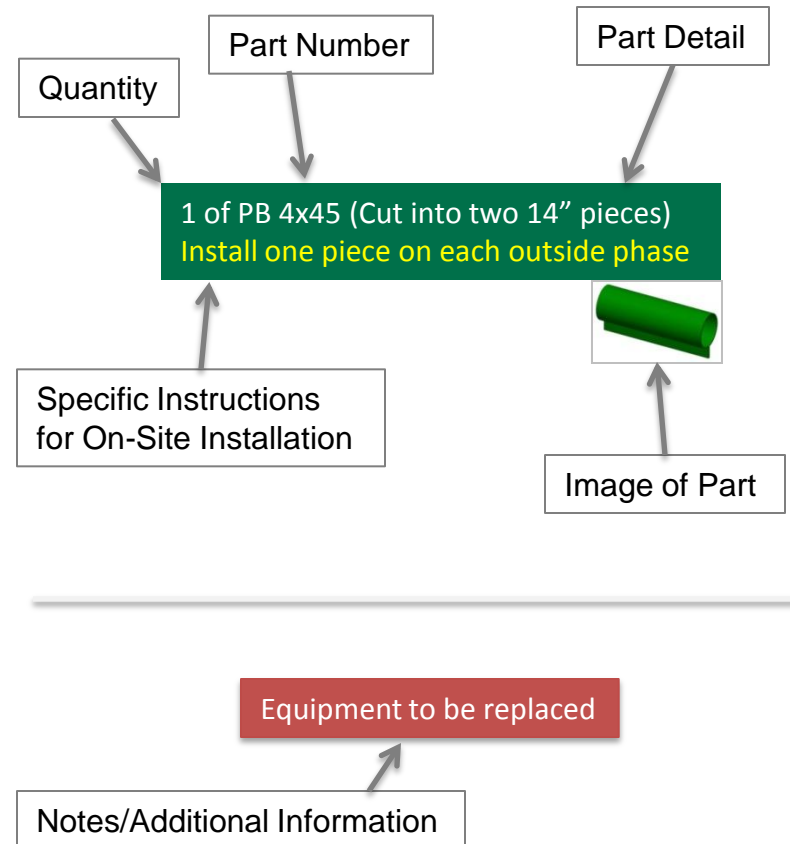

Bus Plug cover is designed to fit snugly around the pipe bus and welded nemapad connector

1 of BP 2.375x4.25-HX



The Site Protection Plan remains the property of Greenjacket® and is not for distribution external of Power Company.



The Site Protection Plan remains the property of Greenjacket® and is not for distribution external of Power Company.